


Emergency Lighting Test Record 2025

DO NOT REMOVE FROM VILLAGE HALL

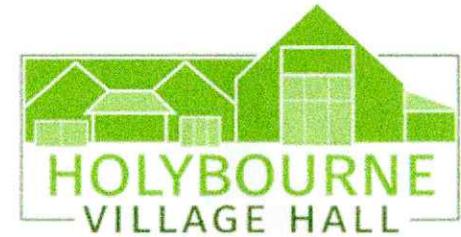

REGISTERED CHARITY NO. 282217

Month	Date	Type (M/A)	Main Hall L1	Main Hall L2	Emergency Exit L3	Entrance Lobby	Main Store	Kitchen	Gents' WC	Ladies' WC	Disabled WC
Jan	18/1	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Feb	16/2	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Mar	16/3	M	✓	✓	✓	✓	✓	X	✓	✓	✓
Apr	13/4	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
May	11/5	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Jun	8/6	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Jul	6/7	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Aug	3/8	A	✓	✓	✓	✓	✓	✓	✓	✓	✓
Sep	15/9	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Oct	14/10	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Nov	16/11	M	✓	✓	✓	✓	✓	✓	✓	✓	✓
Dec	20/12	M	✓	✓	✓	✓	✓	✓	✓	✓	✓

Periodic testing should be carried out monthly by simulating a failure of supply, causing the fitting to be energised from its battery. The interruption of the supply should be carried out by operating a local key switch or other testing/isolation device. During this period, all fittings should be examined to ensure they function correctly. At the end of the test period, the supply shall be restored and all indicator lamps or devices checked to ensure that the normal power supply has been restored.

L1, L2, L3 installed by A.C. Hankin Electrical 12th April 2011; batteries replaced 27th September 2018
 Entrance Lobby, Kitchen and Main Store: CLP/S/CO/840M installed 15th August 2018
 Gents, Ladies and Disabled WC Installed by ECS July 2020

The duration of the simulated failure shall be:

Monthly: a functional test for less than 25% of the rated duration of the fitting.

Annual: a test for the full duration of the fitting (3 hours)

Batteries must be replaced once the rated duration can no longer be met.